



# GARBRY-LOONEY ROUND-A-BOUT

**TRENCH #1**

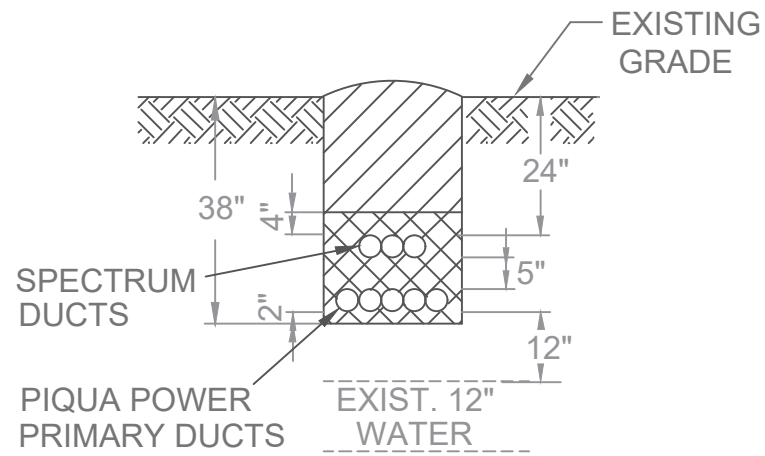


**TRENCH #2**

DEEPEST SECTION  
\*(SEE PROFILE VIEW)

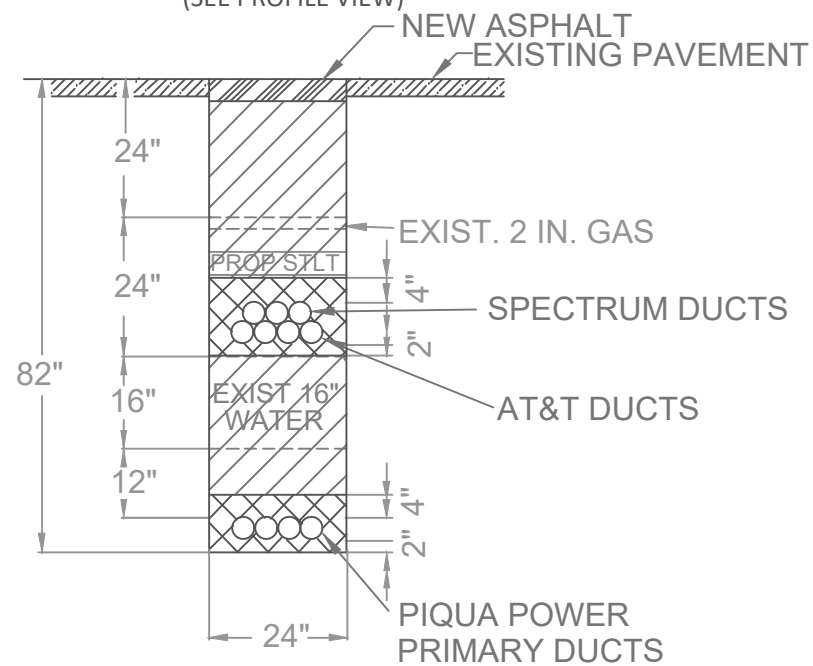


**TRENCH #3**

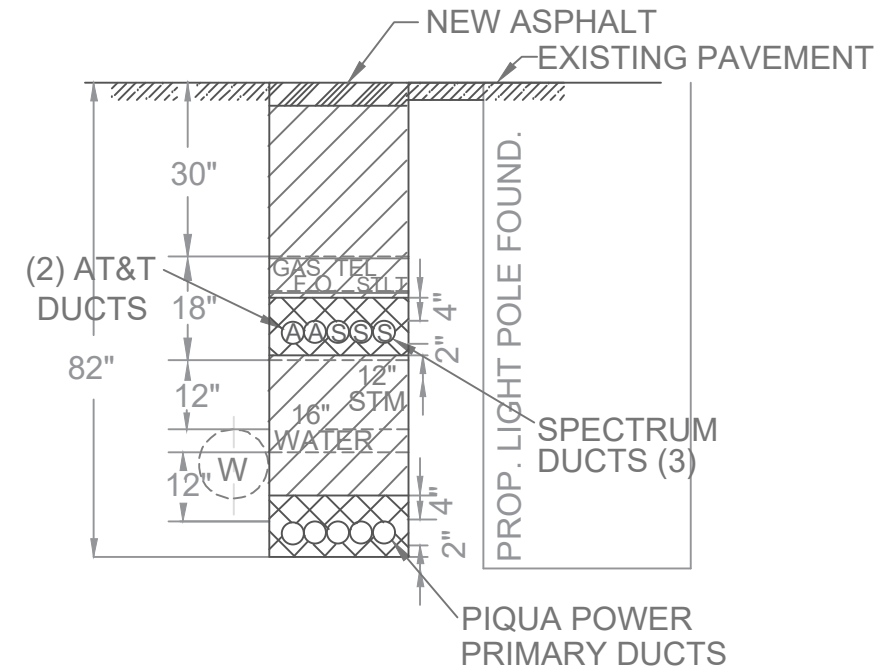



**TRENCH #4**

PIQUA POWER & SPECTRUM

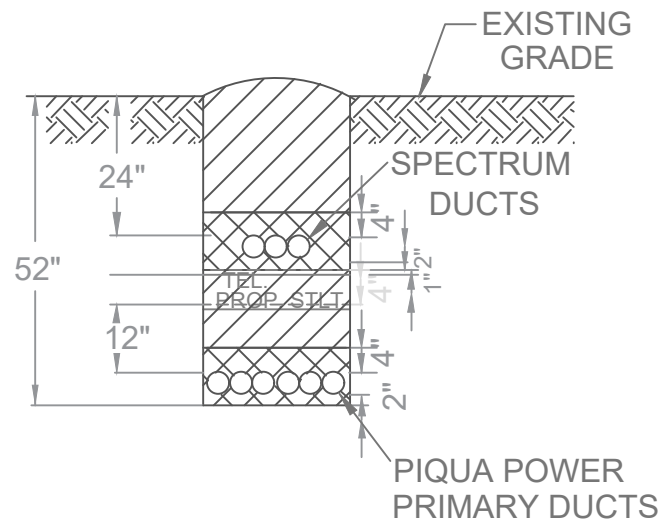


**TRENCH #4**


AT&T

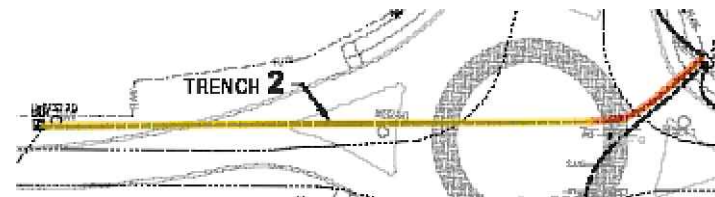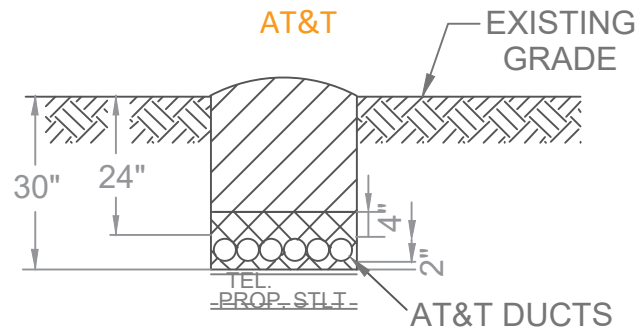

**\*TRENCH #2 PROFILE**

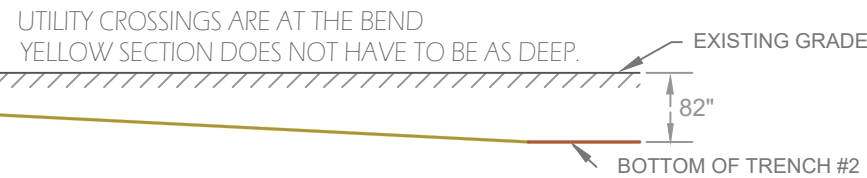

**TRENCH #5**

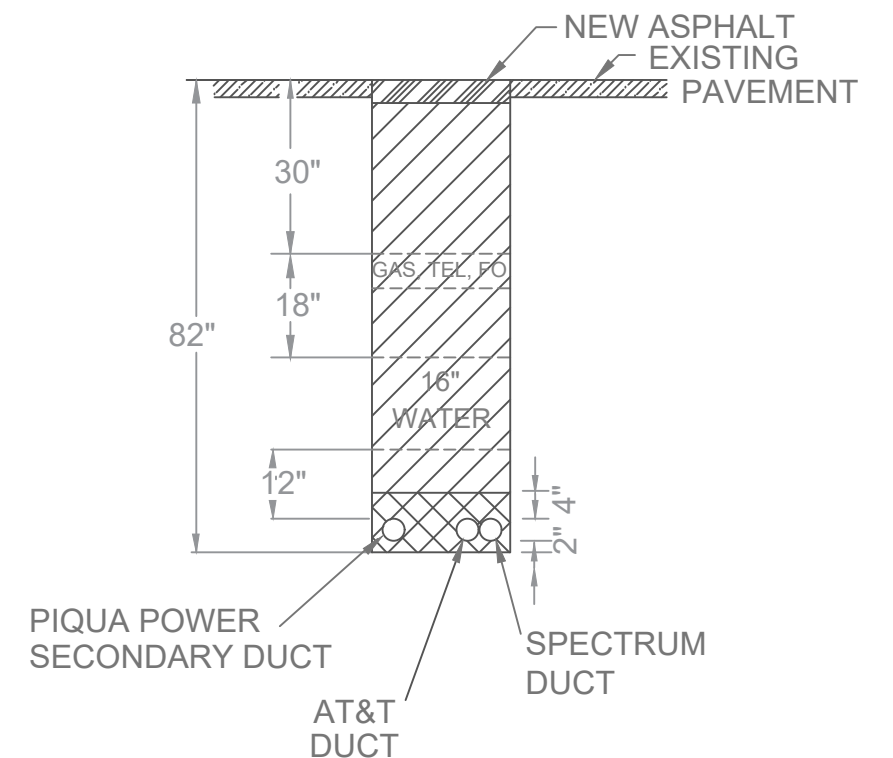

**NOTES:**

- 1- 12" spacing between cable circuits recommended in case of maintenance and repair work.
- 2- Closer spacing is allowable under NESC Rule 320B provisions of exception when all parties agree.
- 3- In some cases where other supports and utilities are involved, greater depth of burial is recommended.

